

UNIFORM BUILDING CODE SMOKE DETECTORS Section 310.9.1

Smoke detectors shall be:




* Required in every dwelling unit, congregate residence and in all guest rooms of hotels and lodging houses.

* Installed when sleeping room added or repairs or additions requiring permit exceed \$1000 valuation.

* Installed in accordance with the approved manufacture's instructions.

* Hard-wired in new construction and equipped with a battery backup (battery-operated permitted in existing buildings).

SPLIT LEVELS

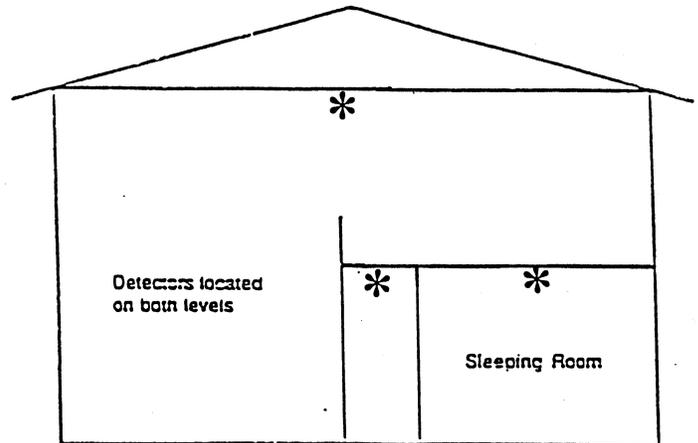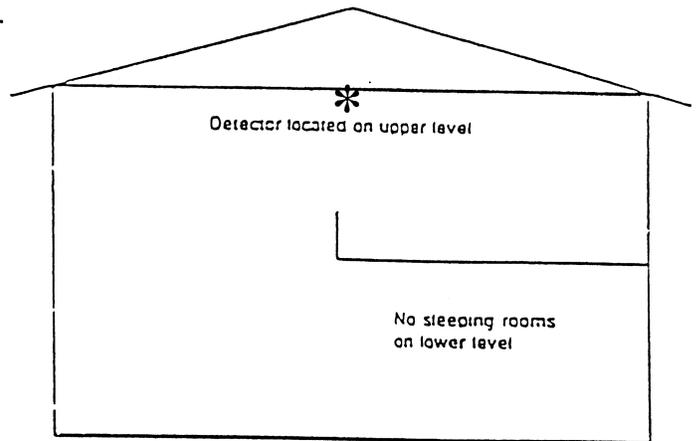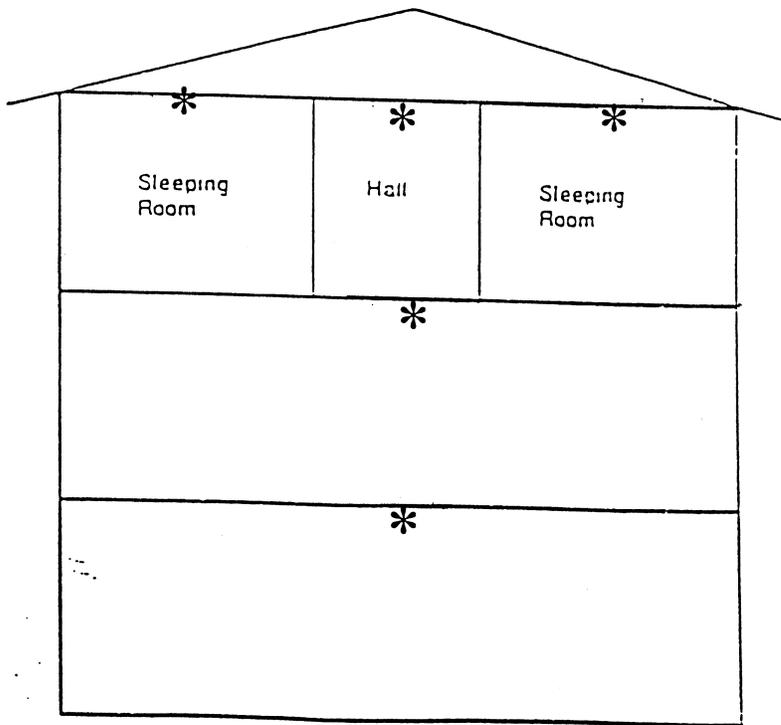

ADDITIONAL
SMOKE DETECTOR

24" or
greater


ROOM OPEN TO HALLWAY

Hallway serving
bedrooms

SMOKE DETECTORS
SAVE LIVES



PRIMARY POWER FROM BUILDING WIRING SERVED FROM COMMERCIAL SOURCE

BATTERY BACKUP

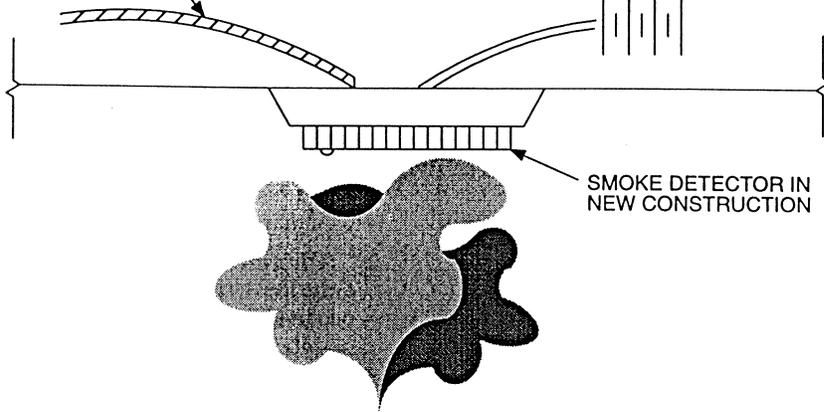


SMOKE DETECTORS

Smoke detectors in each sleeping room

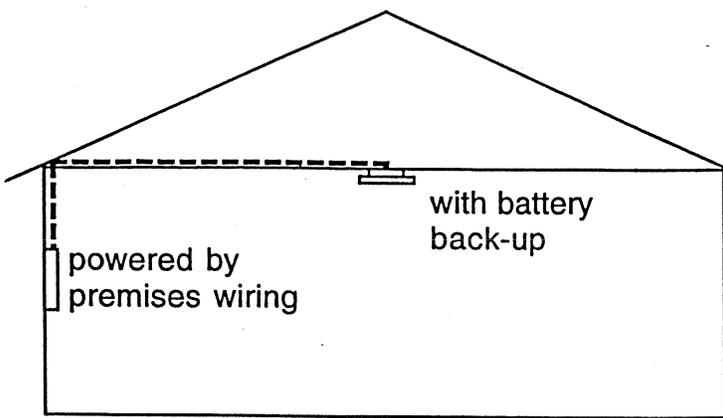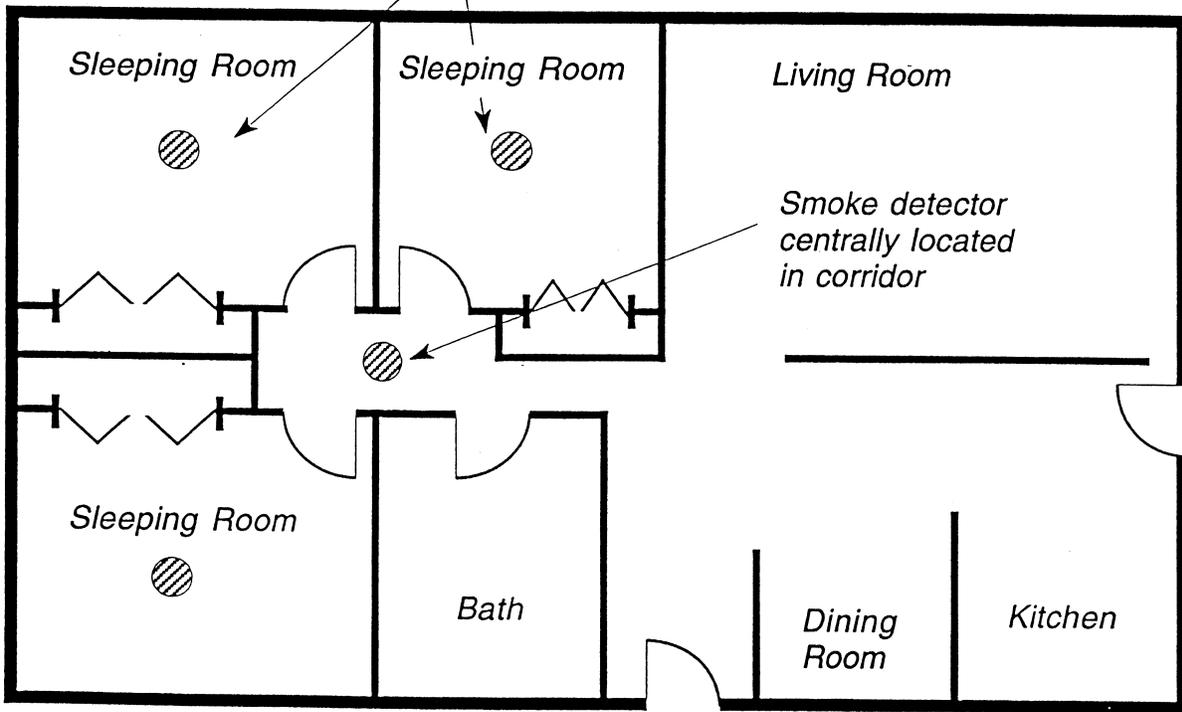

New Construction

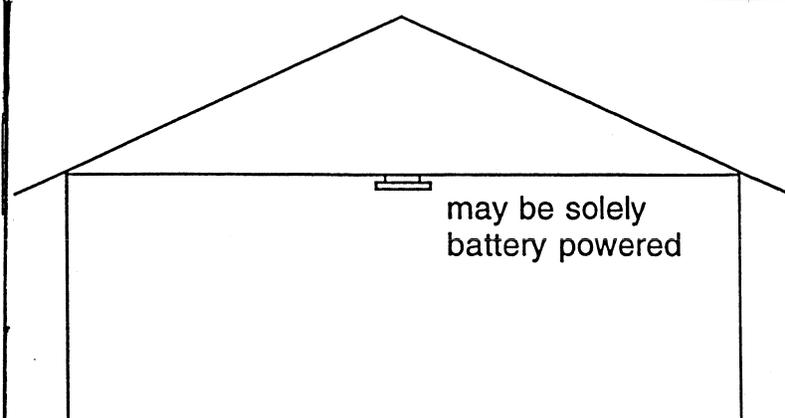

- Existing buildings
- Buildings without commercial power
- Buildings which undergo alterations or repair